


### CUTSHEET

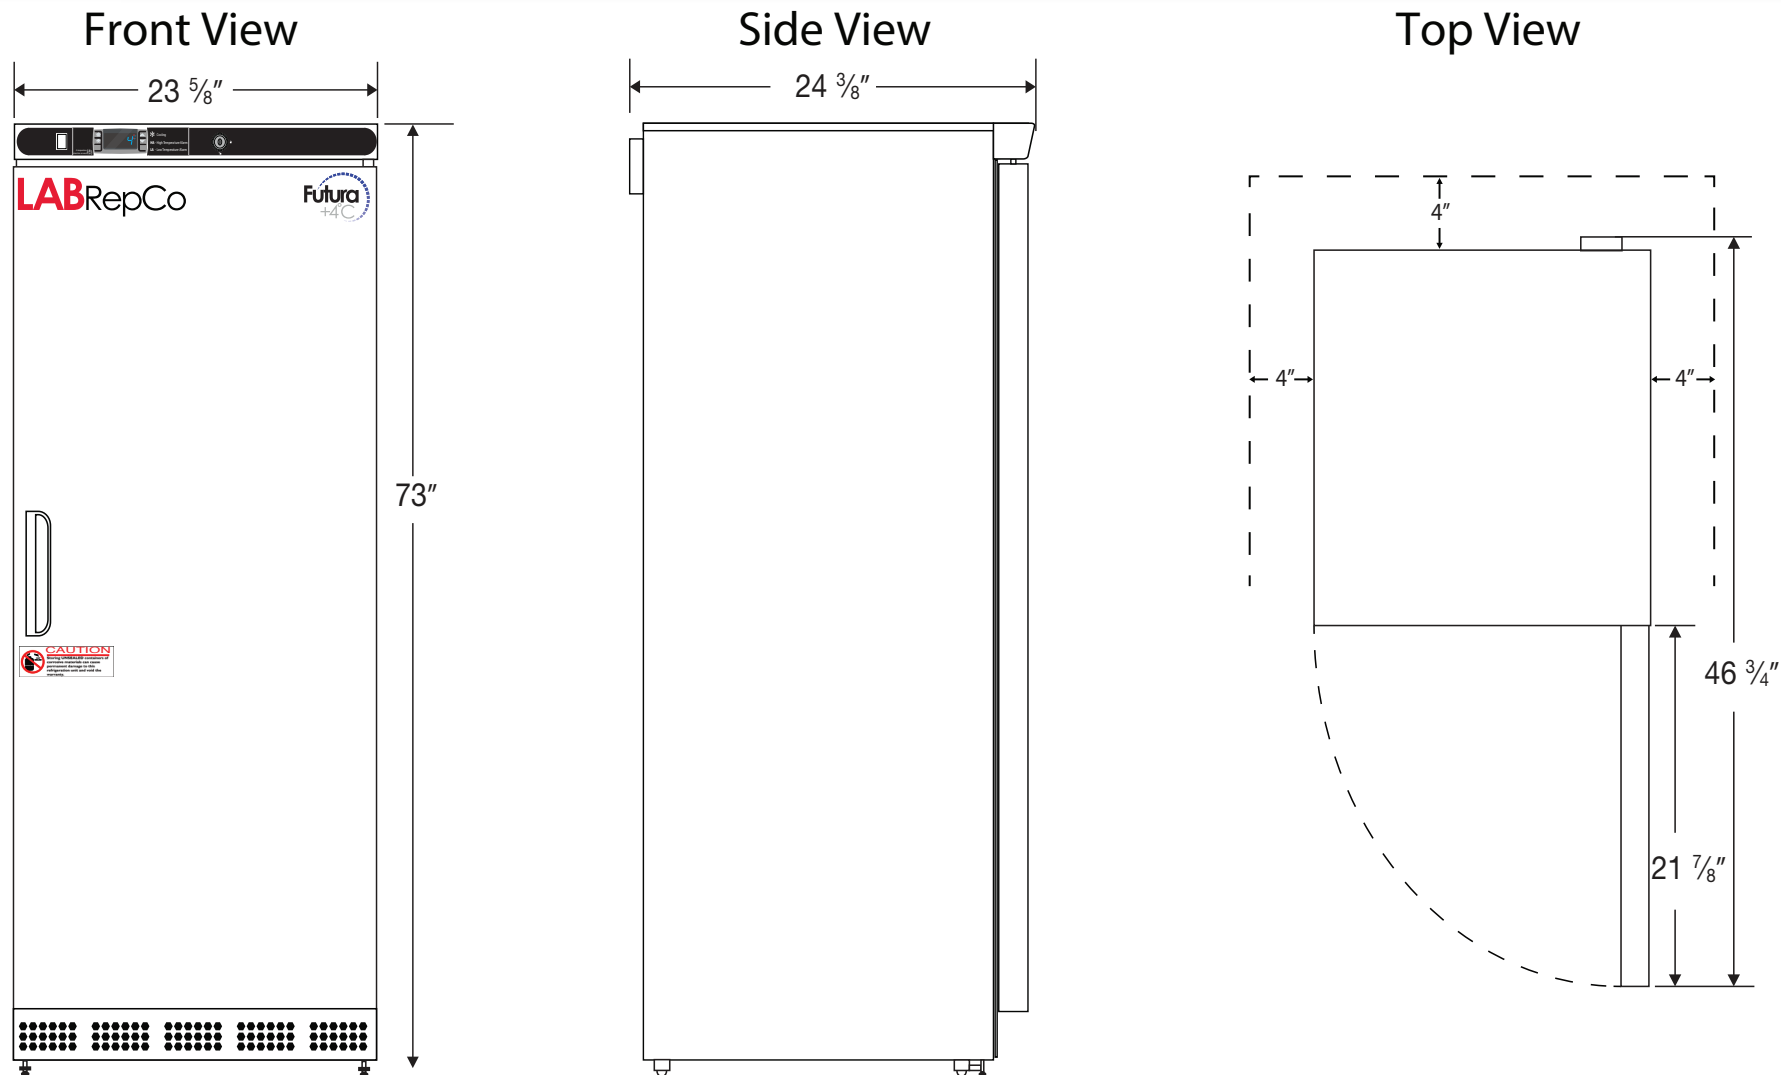

**NOTE: Ventilation Requirements – Minimum 4" clearance on sides and back**

Cu. Ft	Defrost	Door	Int Door	Shelves	W"	D"	H"	Refrigerant	H.P.	Amps	Weight
14	Cycle	1 Solid	0	5 Adj.	$23 \frac{5}{8}$	$24 \frac{3}{8}$	73	R600a	$\frac{1}{5}$	3	170 lbs.